

ECN[®]

DEC 15/12

ecnmag.com



ECN
READERS CHOICE
TECH
AWARDS

2012

Inside This Issue

Editor's View

2012 Readers Choice Awards

Roundtable: The Year in Review

Power Focus

Understand surge protection techniques for low-power outdoor electronics

By Stuart Wood, BEAR Power Supplies,
www.bearpwr.com

New Products



Advantage
Business Media

Vol. 56 No. 15



DIGIKEY.COM

Power Focus

Understand surge protection techniques for low-power outdoor electronics

Growing demand for outdoor electronics puts renewed focus on protection techniques for lightning-induced surges



By **Stuart Wood**,
BEAR Power
Supplies,
www.bearpwr.com

Low-power
industrial
electron-


ics are increasingly found in outdoor applications. Growth drivers include the proliferation of video surveillance systems, adoption of LED lighting, build-out of the smart grid with devices such as pole-mounted RF repeaters, and deployment of a wide range of sensors and monitoring systems for equipment in clean energy, oil, gas and other industries.

The broad and growing range of applications means design engineers are increasingly likely to encounter design projects for equipment that works outdoors. For designers accustomed to creating indoor systems, this means learning new techniques for protecting equipment from lightning-induced surges.

Understanding threat categories

Surge protection standards are based on IEEE Standard C62.41.2, which outlines surge threat levels based on equipment location. Location Category A is inside a building and distant from the electrical service entrance. Category B is indoors on short branch lines closer to the service entrance. Category A and B locations are protected from lightning

Power supply for a smart grid RF repeater features a MOV/GDT combination (in the lower left of the photo) for surge protection.

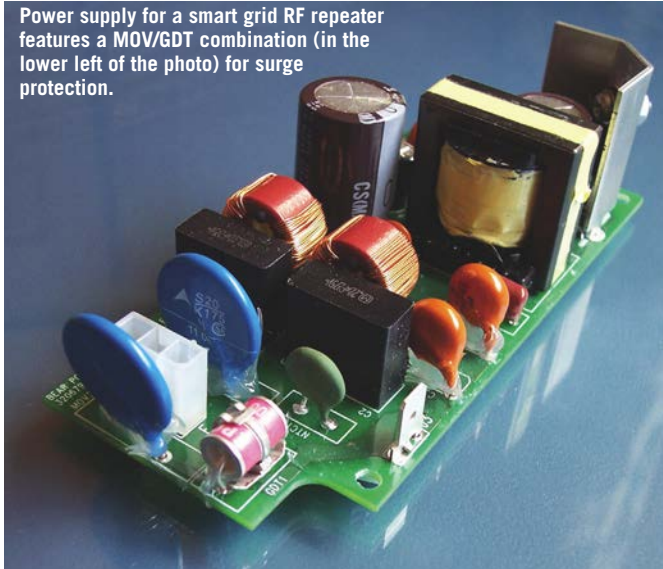


Capacitive Discharge Welding Saves Time and Improves Results

Enjoy the flexibility of the HotSpot Welder line to fabricate thermocouple junctions, attach leads to sensors, filaments and components, and hardware to structures. These capacitive discharge welders are portable, quick and simple to operate. Improve your assemblies with a welded junction to increase reliability.

View a video of sample operations and get specifications and pricing at www.dccCorporation.com.

Contact us at 856-662-7272 or info@dcc-c.com to explore your particular applications.

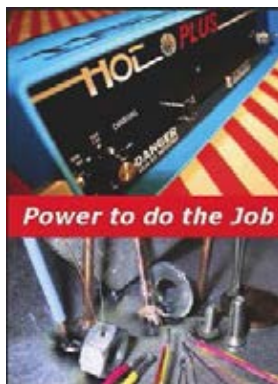

PICO

AC-DC Converters
Power Factor Corrected

5-300VDC

Isolated DC Output

Low Cost
Industrial


UP TO
300
WATTS

Two Units in One
AC1 Series



Universal AC Input
47-400Hz
Input Frequency

- **STANDARD:** 5 to 300 VDC regulated, ISOLATED outputs/Fixed frequency
- **ALL in ONE** compact full brick module, 2.5" x 4.6" x 0.8" Vacuum encapsulated for use in rugged environments
- **Lower cost** for your Industrial applications
- **Maximize your design** up to 300 watt models
- **Meets Harmonic Distortion** specifications
- **.99 Power factor** rating at operational levels
- **Expanded operating temperatures** available -40 & -55C, +85 & 100C base plate
- **Custom models** available

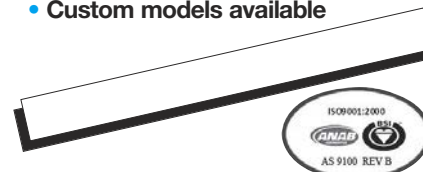

PICO Electronics, Inc.

143 Sparks Ave, Pelham, NY 10803-1837

Call Toll Free 800-431-1064 • FAX 914-738-8225

When it matters...



GORE® Electronic Materials

Enhance performance and increase design flexibility in your electronic systems with the latest EMI shielding and RF grounding solutions from Gore.

gore.com/emi

EMI GASKETS AND
GROUNDING PADS



Surge Waveform	Category A	Category B	Category C - Low exposure	Category C - High exposure
0.5 μ s - 100 kHz ring wave	6 kV / 0.2 kA	6 kV / 0.5 kA	6 kV (optional, for cases where front-of-wave response may be a concern)	6 kV (optional, for cases where front-of-wave response may be a concern)
1.2/50 μ s - 8/20 μ s combination wave high-energy surge	6 kV / 0.5 kA	6 kV / 3 kA	6 kV / 3 kA	10 kV / 10 kA (done as separate current and voltage tests)

Table 1 presents guidelines for developing design parameters and tests. Ideally you would consider both exposure levels and the source of surges. For instance, if the device will be used in areas with high lightning activity but little switching activity, give the combination wave more weight than the ring wave. If the devices will be used in a broad range of locations and types of exposure, design for the "typical" rather than the extreme unless life-support or similar stringent requirements apply. IEC 6100-4-5 and UL-1449 standards provide additional information about test requirements.

Source: IEEE

surges by commercial surge protection devices (SPD) at the building service equipment panel, as well as by their distance from the source of the surge.

Location Category C covers the area from the line transformer outdoors and extending just into the building. This category is divided into "low exposure" and "high exposure" levels depending on a number of factors, including the type and amount of lightning exposure expected. This article will focus on Category C, low exposure.

Test wave recommendations

Lightning surge test recommendations presented in IEEE C62.41.2 include the 0.5 μ s to 100 kHz ring wave and the 1.2/50 μ s to 8/20 μ s combination wave. The combination wave includes a short-circuit current (from direct flashes and near-flash effects) and an open-circuit voltage (from far flashes and near-flash effects).

The ring wave is a lower energy, higher frequency waveform. It is relatively easy to filter using line filters or standard transient voltage suppressors (transorbs). The combination waveform represents higher-energy surges and requires a different suppression approach.

Buy or design?

Commercial SPDs used at a building service entrance are typically DIN rail mounted and measure about 3x3 inches. In theory they may be used to protect individual Category C devices, but they are generally too large and expensive to incorporate into the enclosure for a remote monitor, smart grid RF repeater, surveillance camera or similar device. Therefore high-energy surge protection must be part of the system design for effective protection with the smallest size and lowest cost.

Types of surge protection devices

Surge protection devices can employ either clamping or crowbar techniques. A clamping device begins conducting when the voltage across it exceeds its rated level, and stops conducting (extinguishes) when the surge voltage drops below that threshold. Silicon avalanche diodes (commonly known as Transorbs) and metal oxide varistors (MOVs) are typical clamping devices.

A crowbar device begins conducting when the voltage across it exceeds a rated level, at which point the device impedance drops rapidly along with the voltage across it. Crowbar devices don't extinguish until current stops flowing, and therefore follow-on current due to the AC line will continue to flow long after the transient has passed. Because this follow-on current can significantly reduce the life of the device being protected, additional circuitry is used to release the current after one or more zero crossings. Gas Discharge Tubes (GDTs) are crowbar devices.

Protecting Category B & C equipment

For Category A equipment, a simple and common surge protection technique is to place a MOV across the line. MOVs offer excellent overall protection, with good energy and current handling capabilities. They have low let-through voltage (Figure 1) so very little of the leading edge of the transient above the DC breakdown voltage is let through before the device starts to conduct. This means there is little EFT coming through. They also stop conducting when the voltage across them drops below the breakdown voltage, meaning no follow-on current problems.

For suppressing high-energy transients experienced by Category B and C equip-

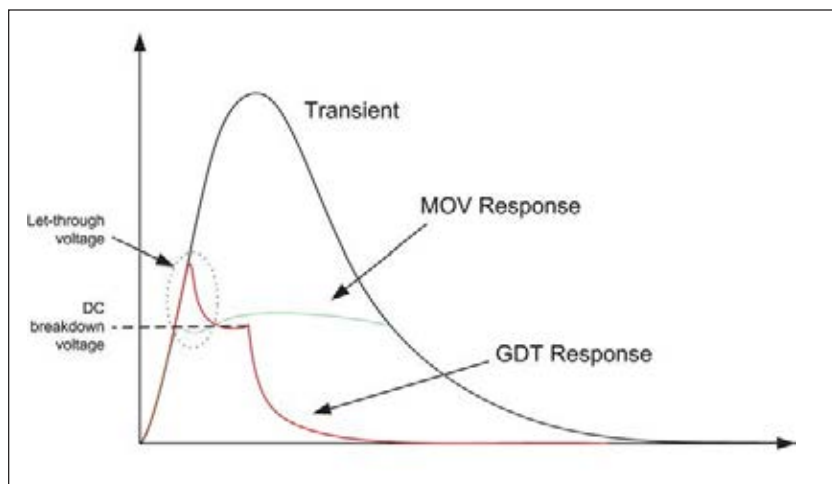


Figure 1. Let-through voltage for a MOV and GDT in response to a transient. Source: BEAR Power Supplies

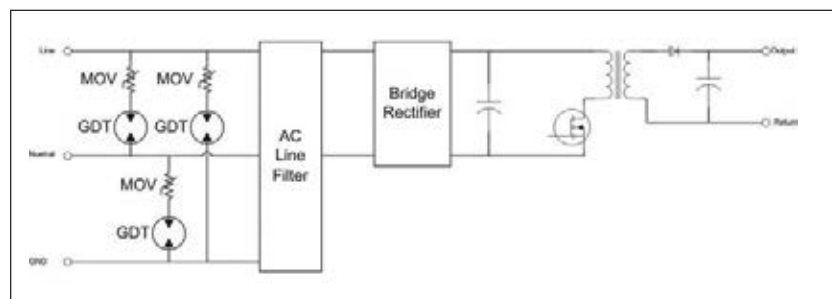


Figure 2. Combination protection circuit using MOVs and GDTs. Source: BEAR Power Supplies

ment, GDTs perform better than MOVs. However, GDTs have poor let-through voltage (Figure 1) and follow-on current characteristics. Therefore a good approach for Category C equipment is to combine a GDT in series with a MOV (Figure 2). The UL standard 1414 (6th edition) outlines the component requirements and provides examples of recognized combinations that are in compliance.

Using this combination allows the designer to choose a lower-voltage MOV than would be needed if the MOV alone were placed across the line. Lower-voltage MOVs offer the benefit of handling more current for a given energy rating. The MOV acts as a limiter for follow-on current to the GDT.

Silicon avalanche diodes can be used as secondary protection if needed. They are effective at handling fast transients and have no follow-on current after the transient has passed. They are generally not used as primary protection because of their lower energy handling capability.

Additional design considerations

Use the AC line filter to your advantage to separate primary and secondary protection.

www.ECNmag.com • 12/15/2012

The filter will slow down and reduce the amplitude of the let-through voltage, and the secondary protection device can clamp it to the desired safe voltage.

Know the failure point of the device to be protected. Your surge protection should limit the energy to be below that level, but not too far below. For example, if your device can take a low-energy 2-kV spike, you should clamp to 1.5 kV rather than 1 kV. Over-designing the protection adds unnecessary costs.

Pay close attention to board layout.


Avoid creating any path for a transient to cross the board. Be aware of instances such as mounting holes which may create unintended paths to ground. One technique is to provide a clean, short, low-inductance path to the AC line ground, and/or a single chassis ground mounting hole located near the AC input.

Surge protection lifetime

A MOV or GDT degrades each time it fires and will eventually fail, causing a short. Lifetime depends on the number and energy of the surges. Most manufacturers suggest replacing the device after 10 surges, but many monitoring devices are deployed in hard-to-reach locations and labor costs to replace or repair them are very high. Higher-rated components (for energy, current and lifetime specs) can add significantly to the system cost. By appropriately combining devices and using the line filter, you can provide long-lasting surge protection for Category C equipment while keeping design costs down.

For more information call BEAR Power Supplies at 1-800-551-2327 or email techinfo@bearpwr.com

When failure is not an option...

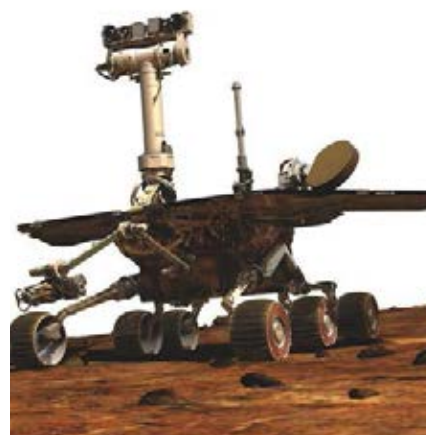

GORE® Wire and Cable

When reliability, durability, and performance can be compromised by harsh environments, GORE® Wire and Cables offer the best solution.

gore.com/electronics

WIRE AND CABLE

